



Exhaust air ducting via the plinth

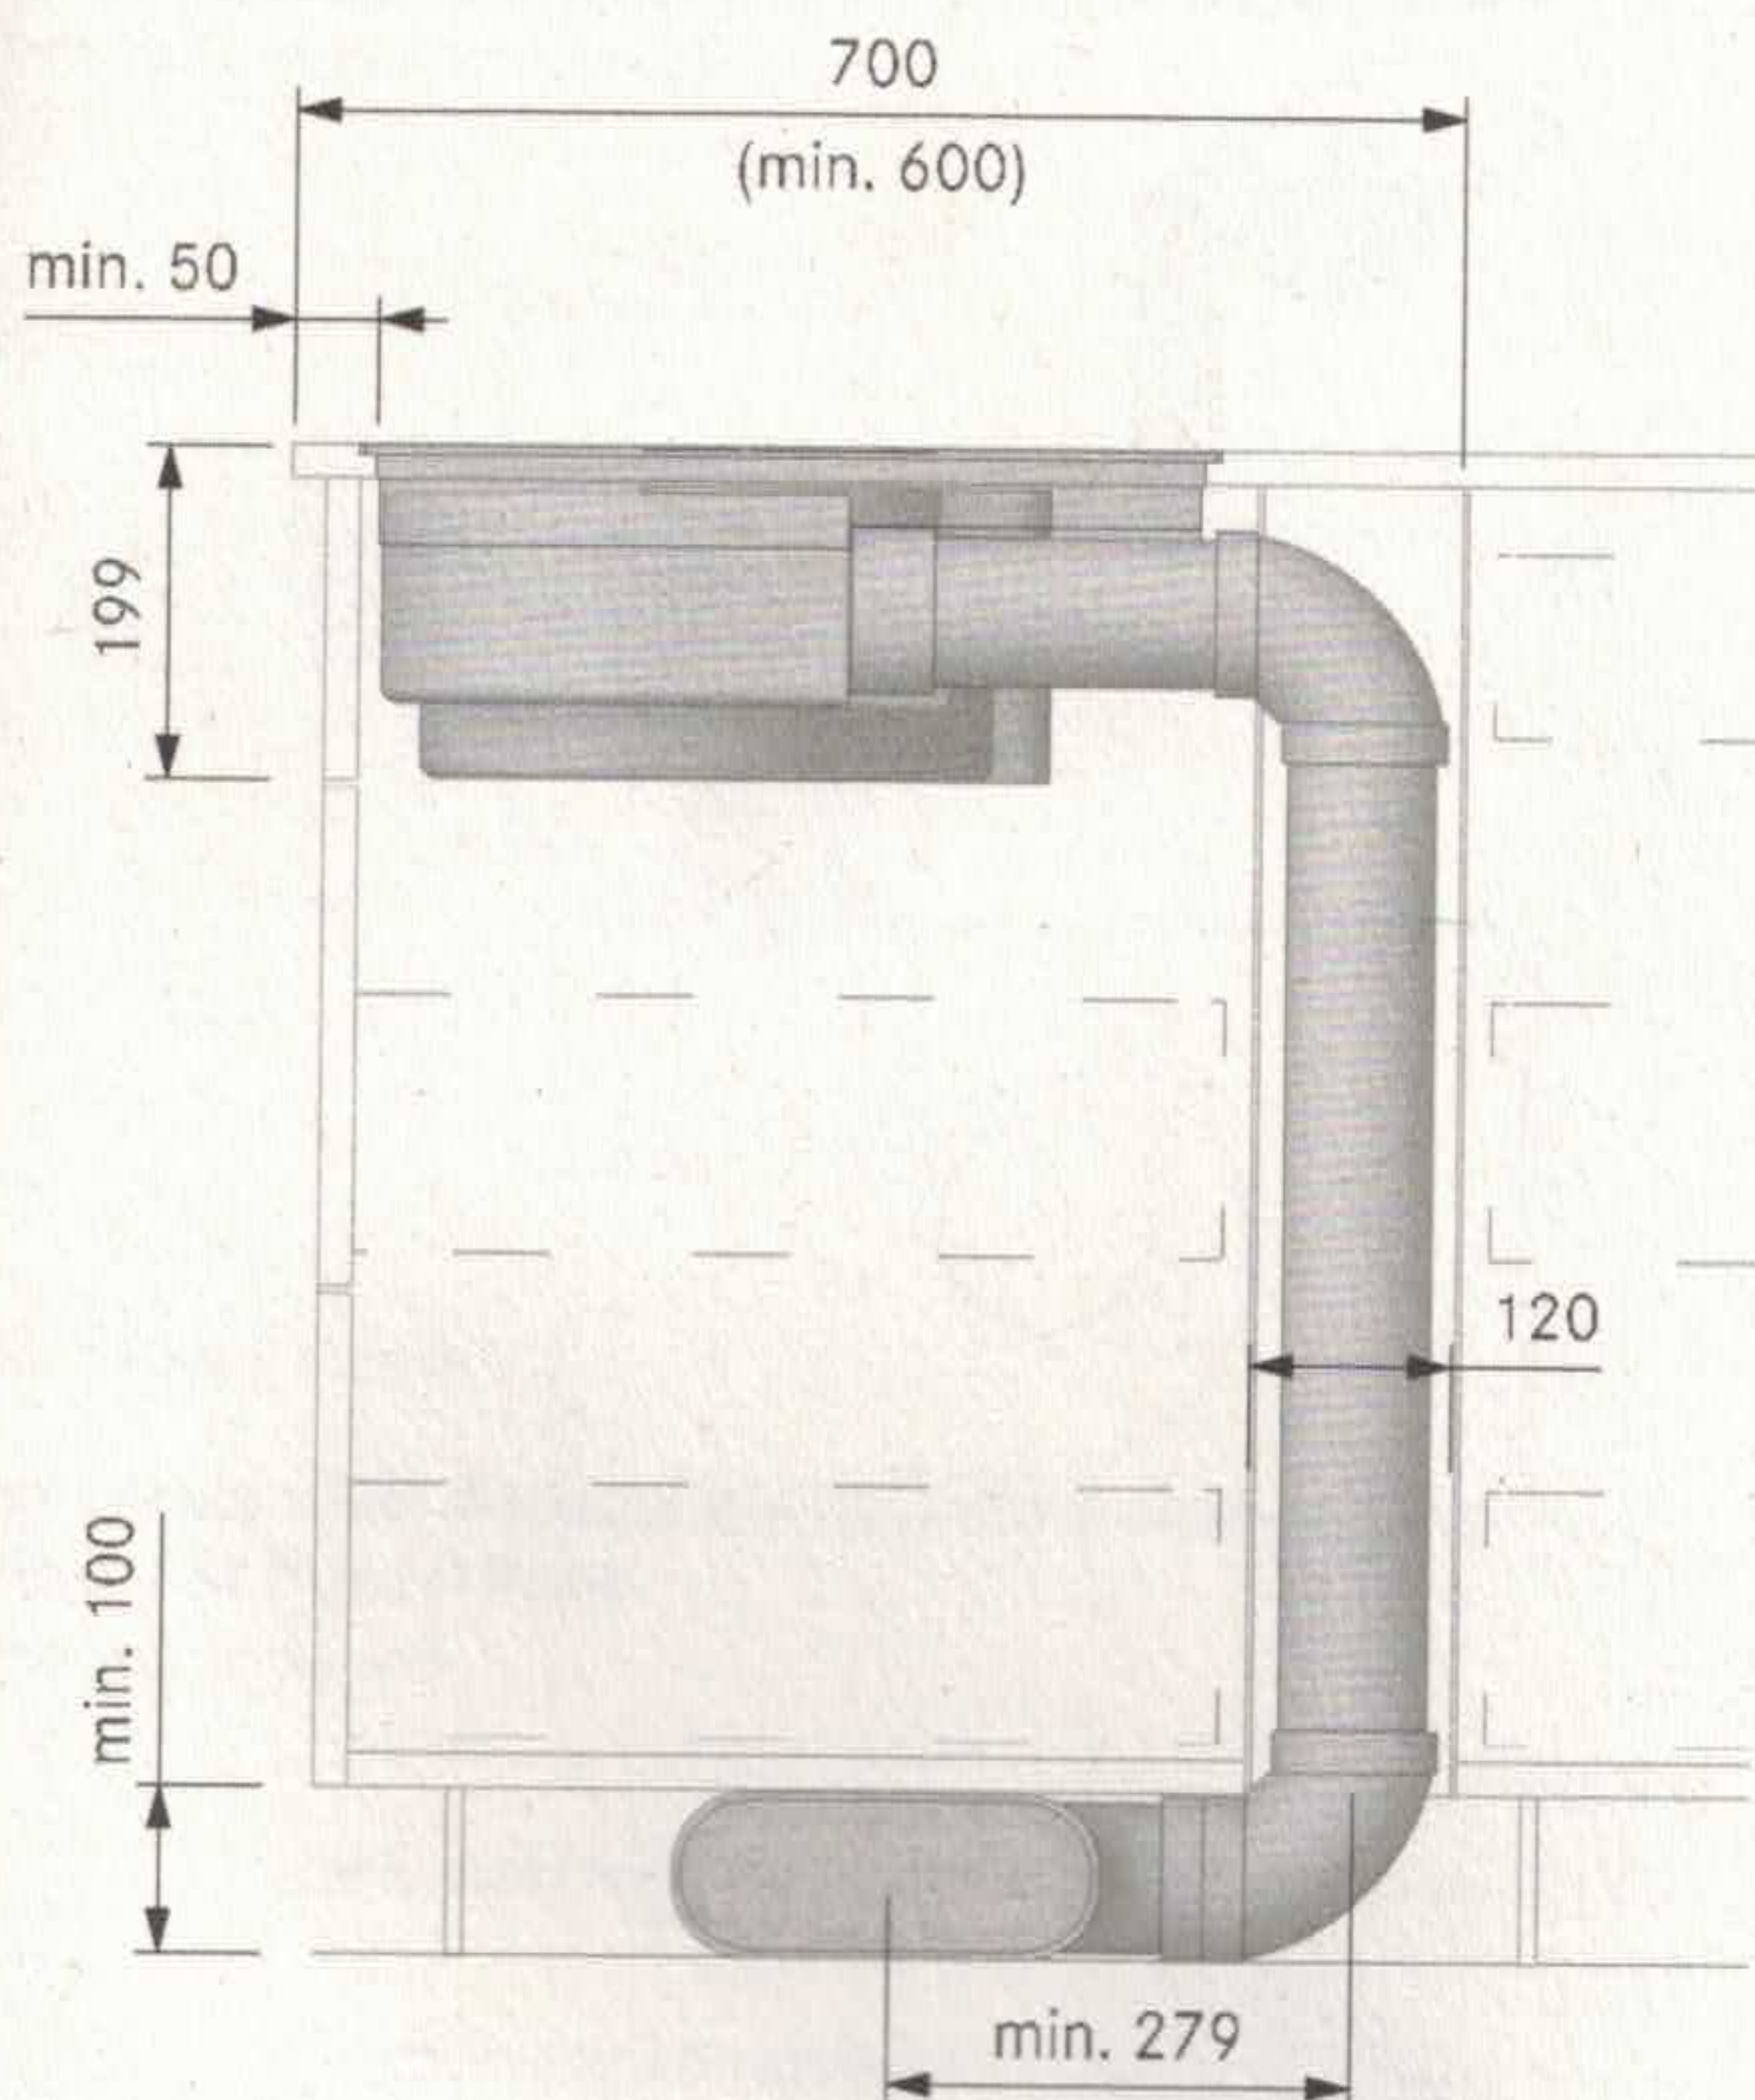


Recirculation ducting (600 mm deep)

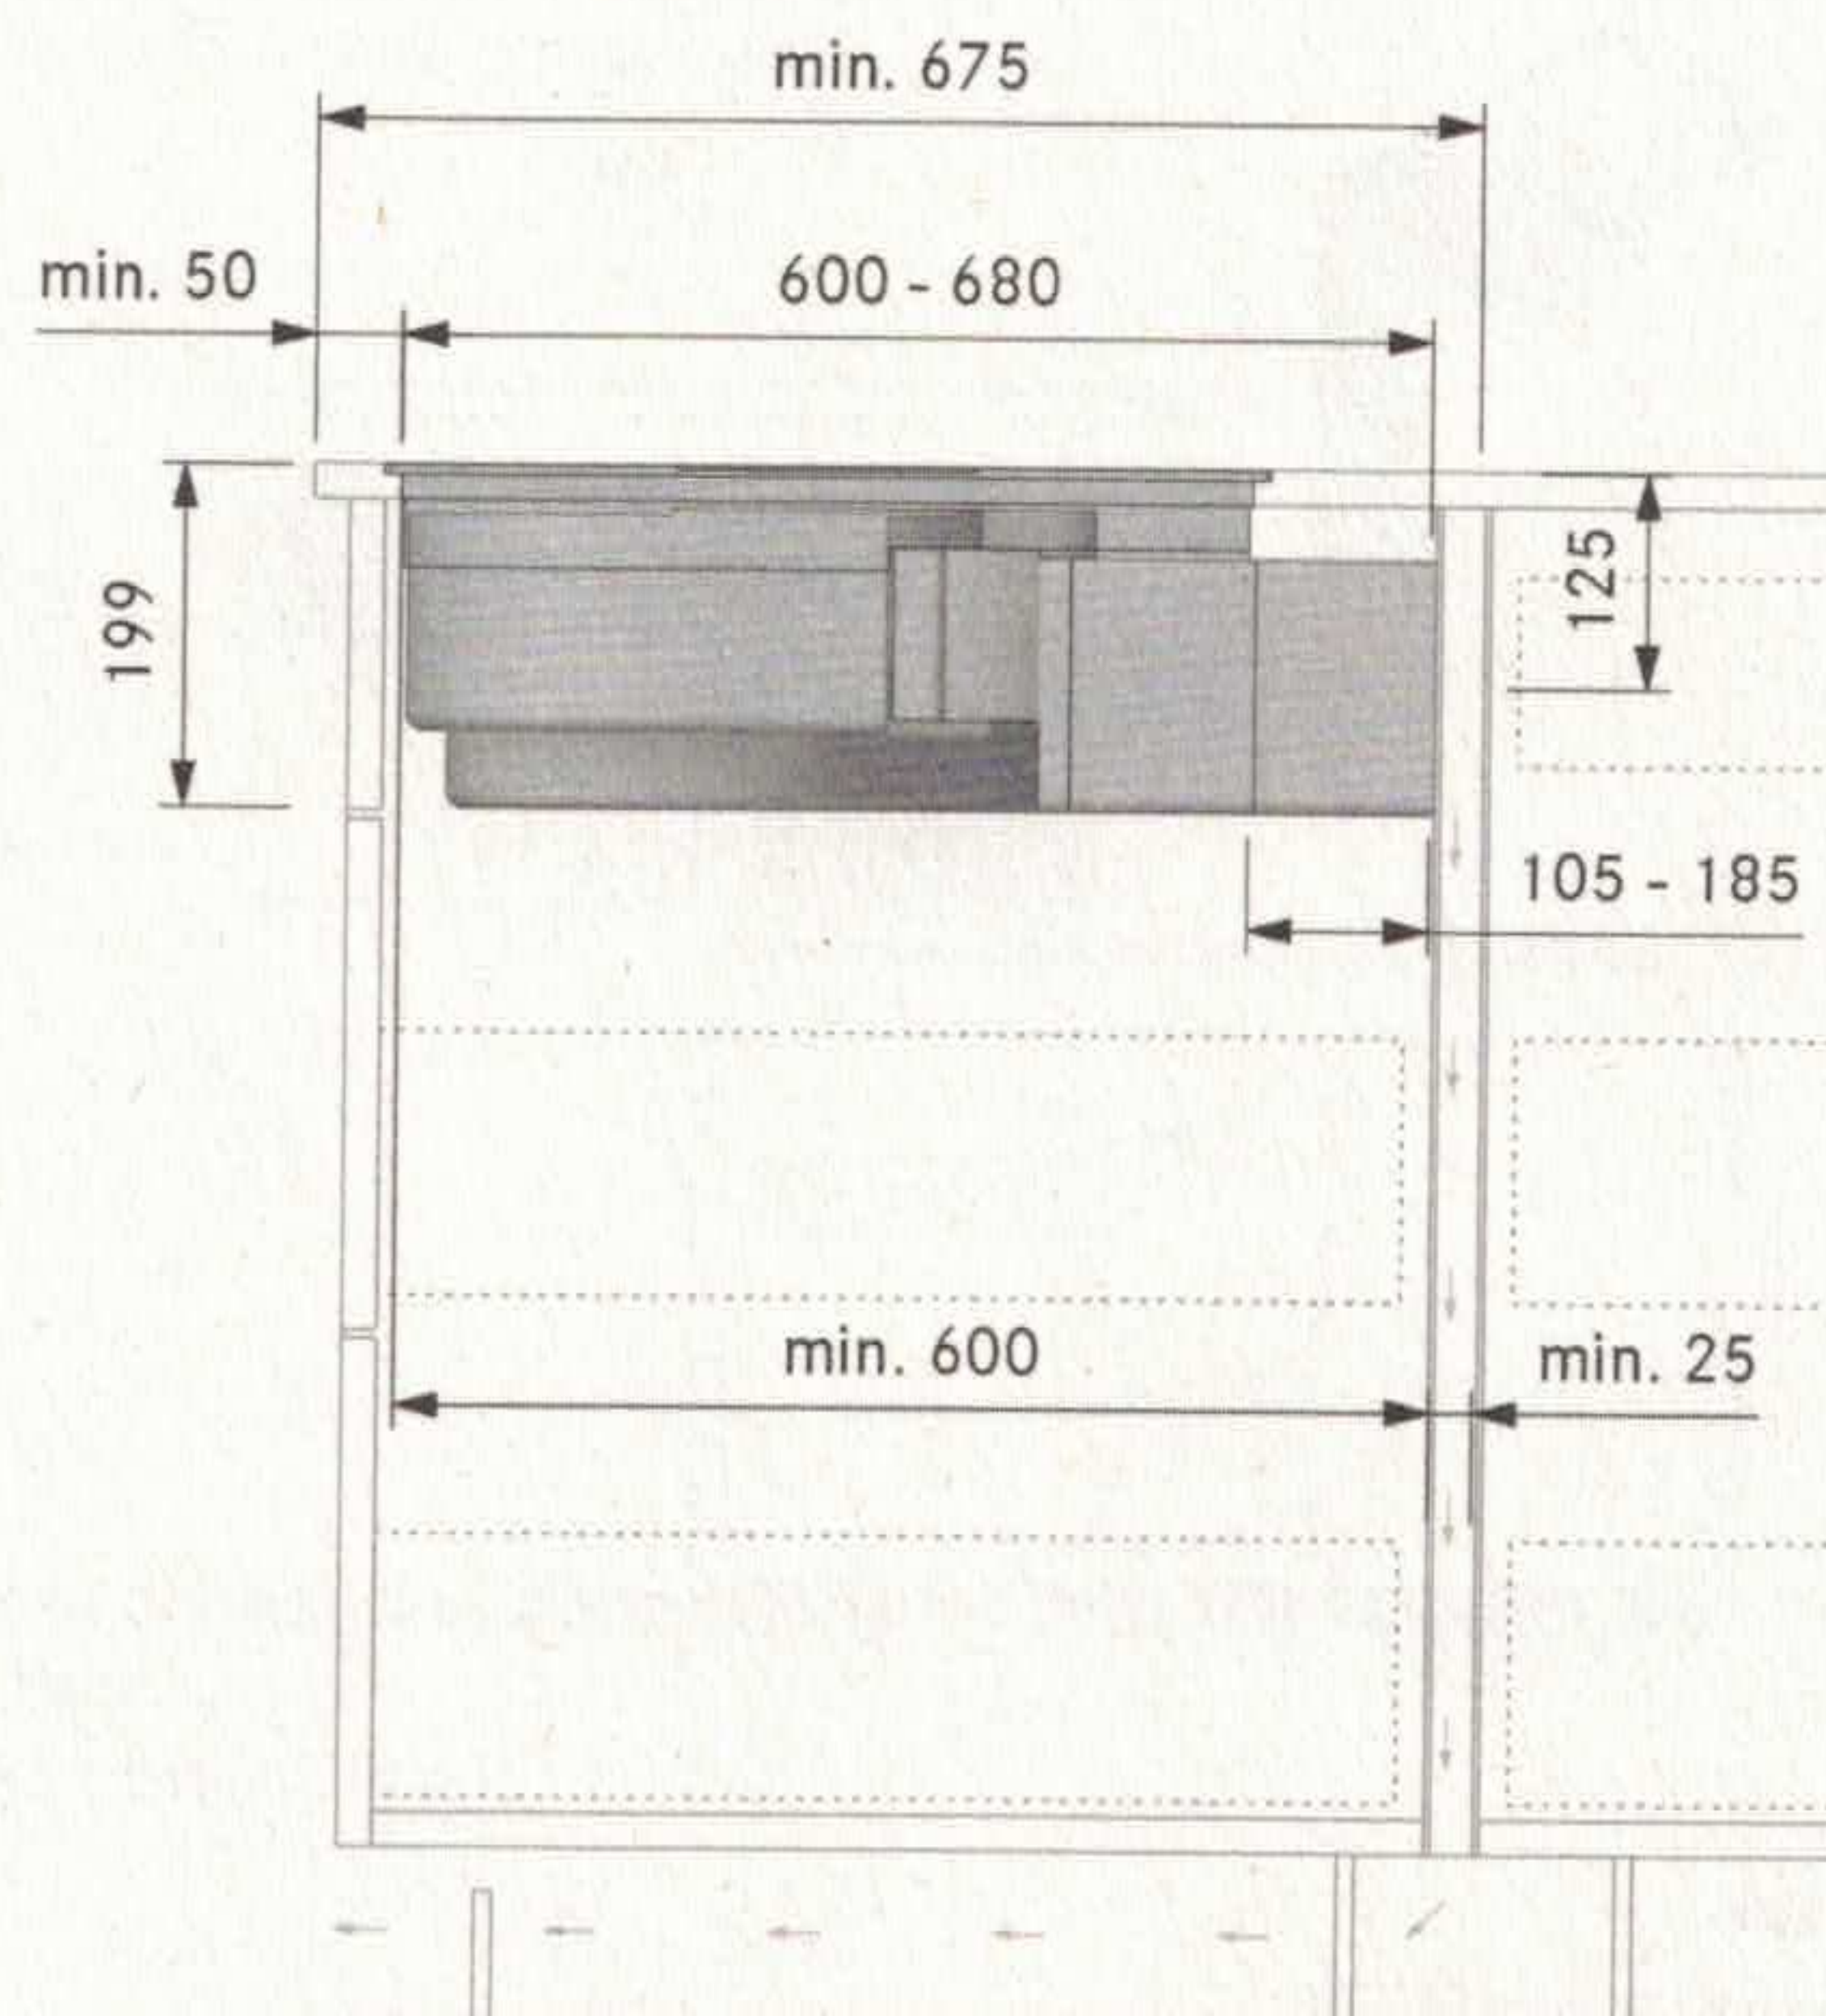


Recirculation ducting with additional telescopic extension PULBTA

(for extra-deep units)

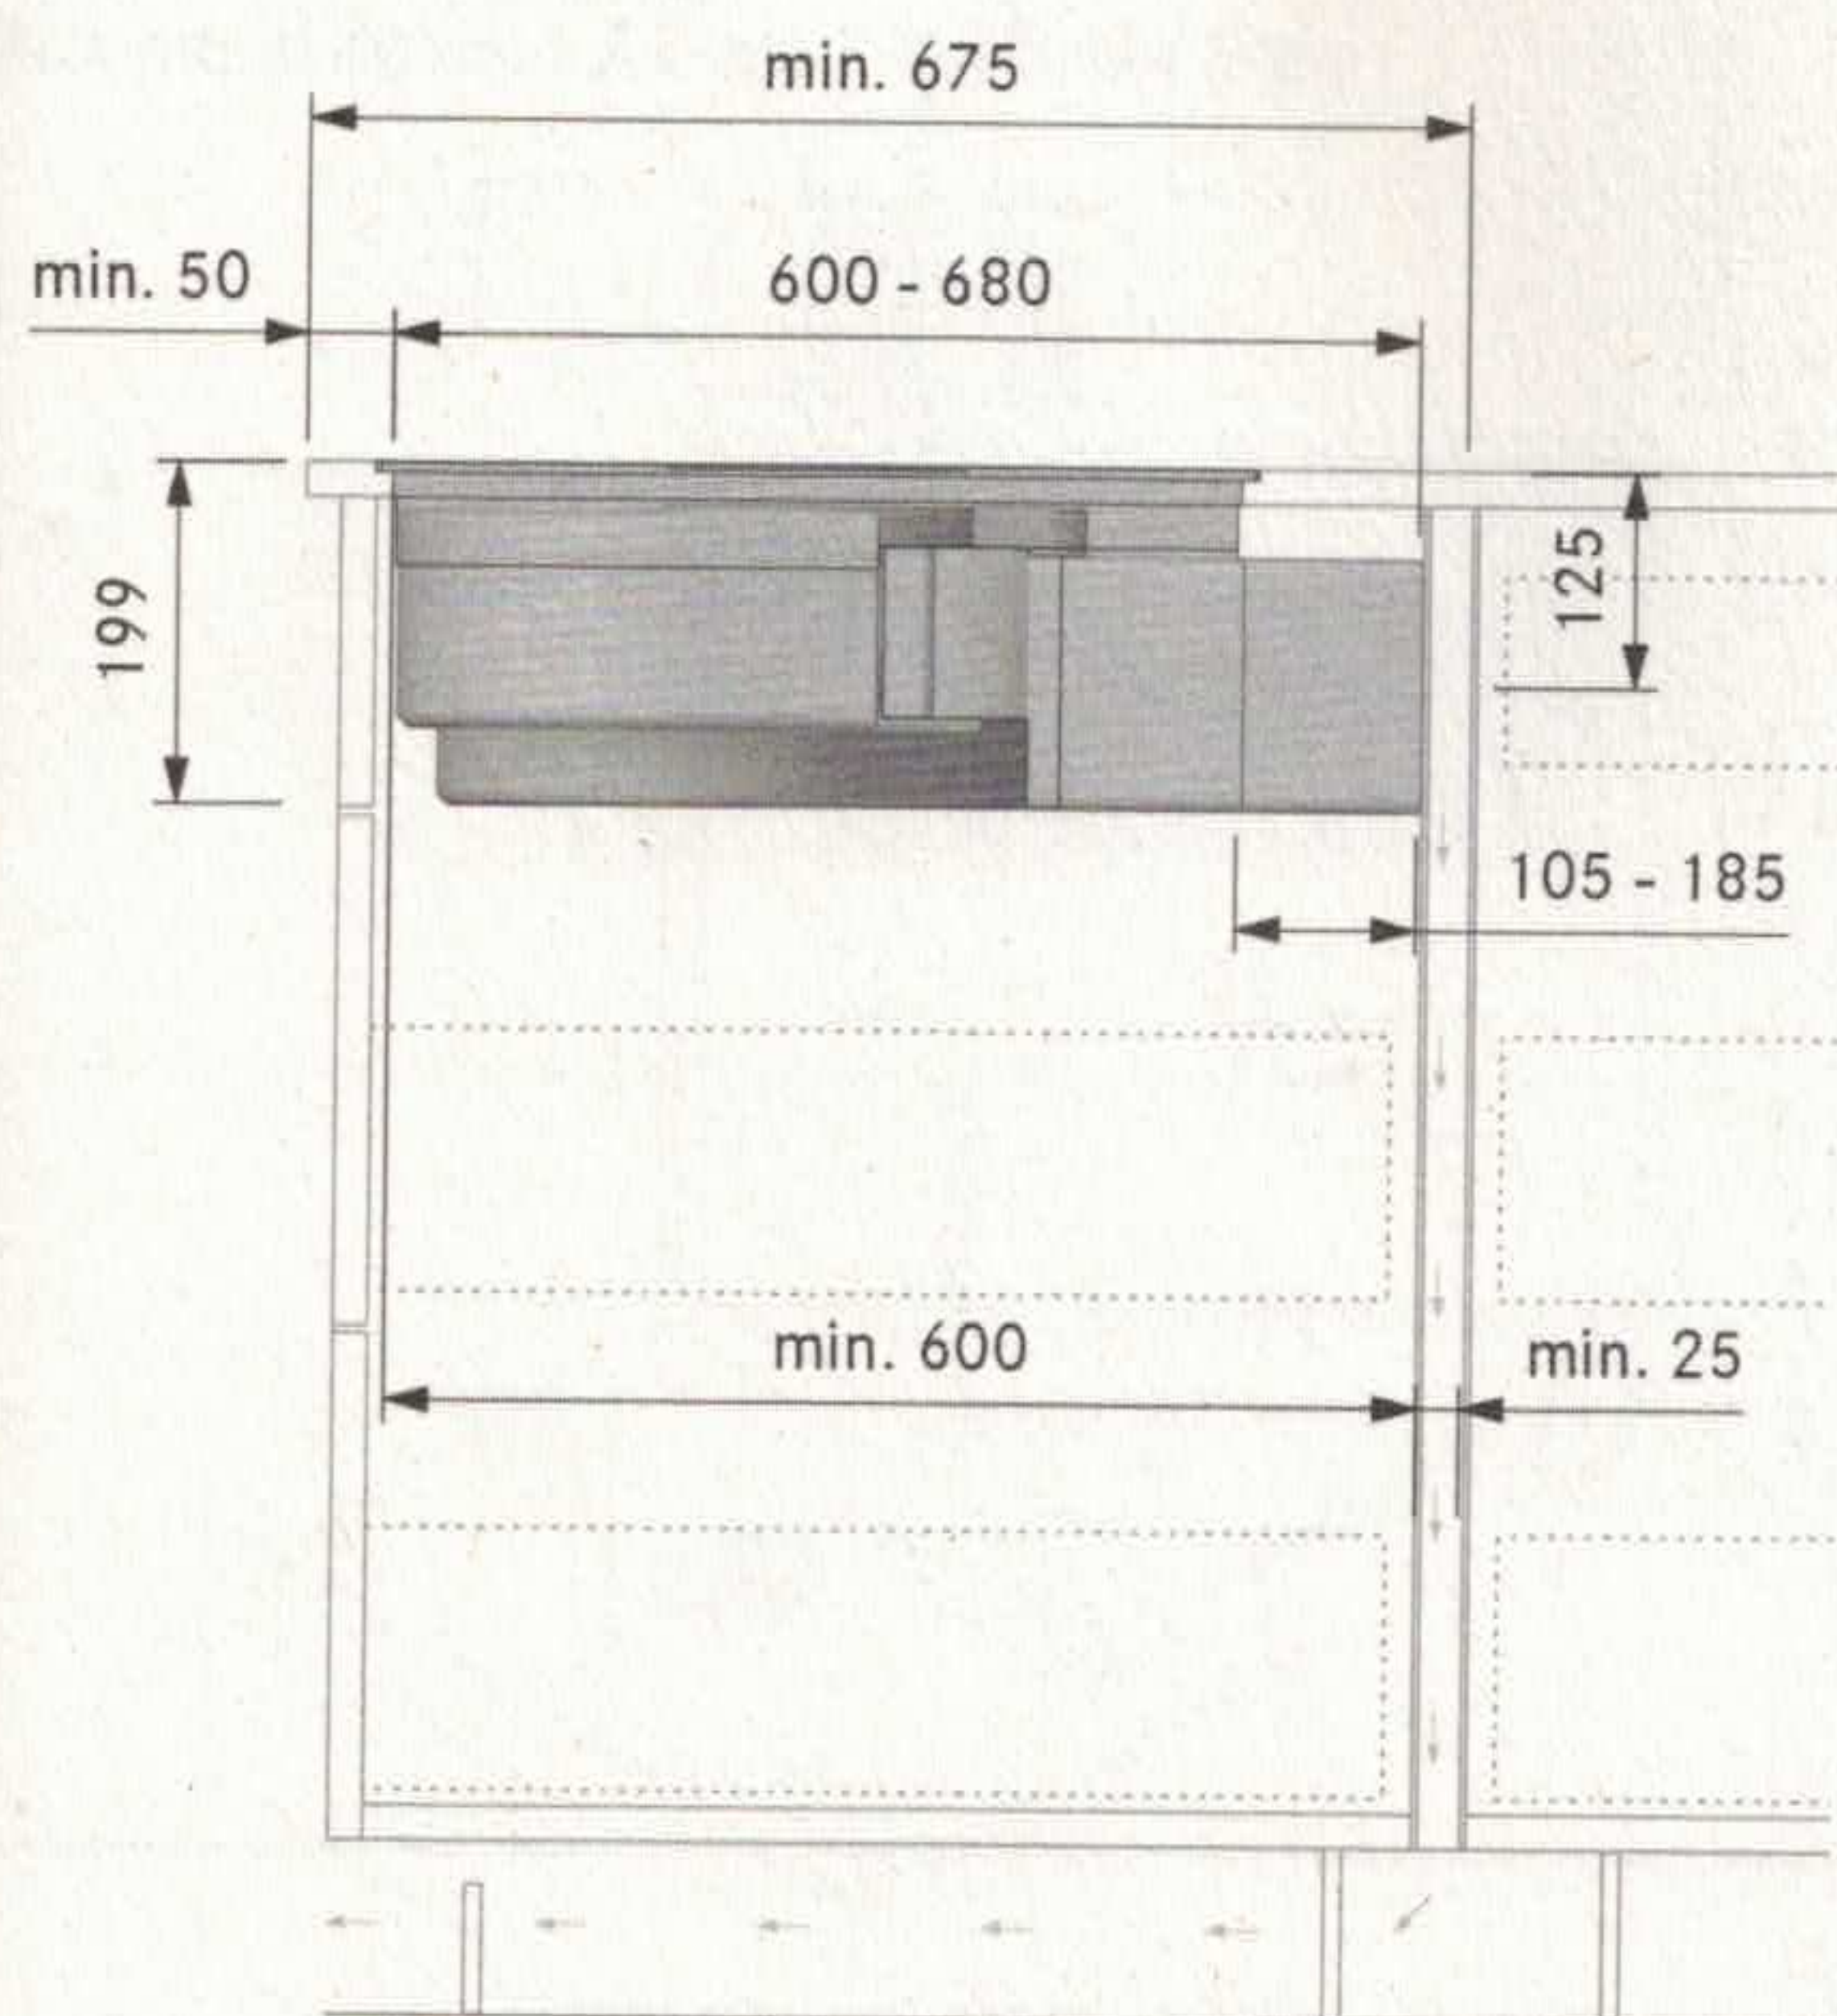

Recirculation ducting with dividing shelf

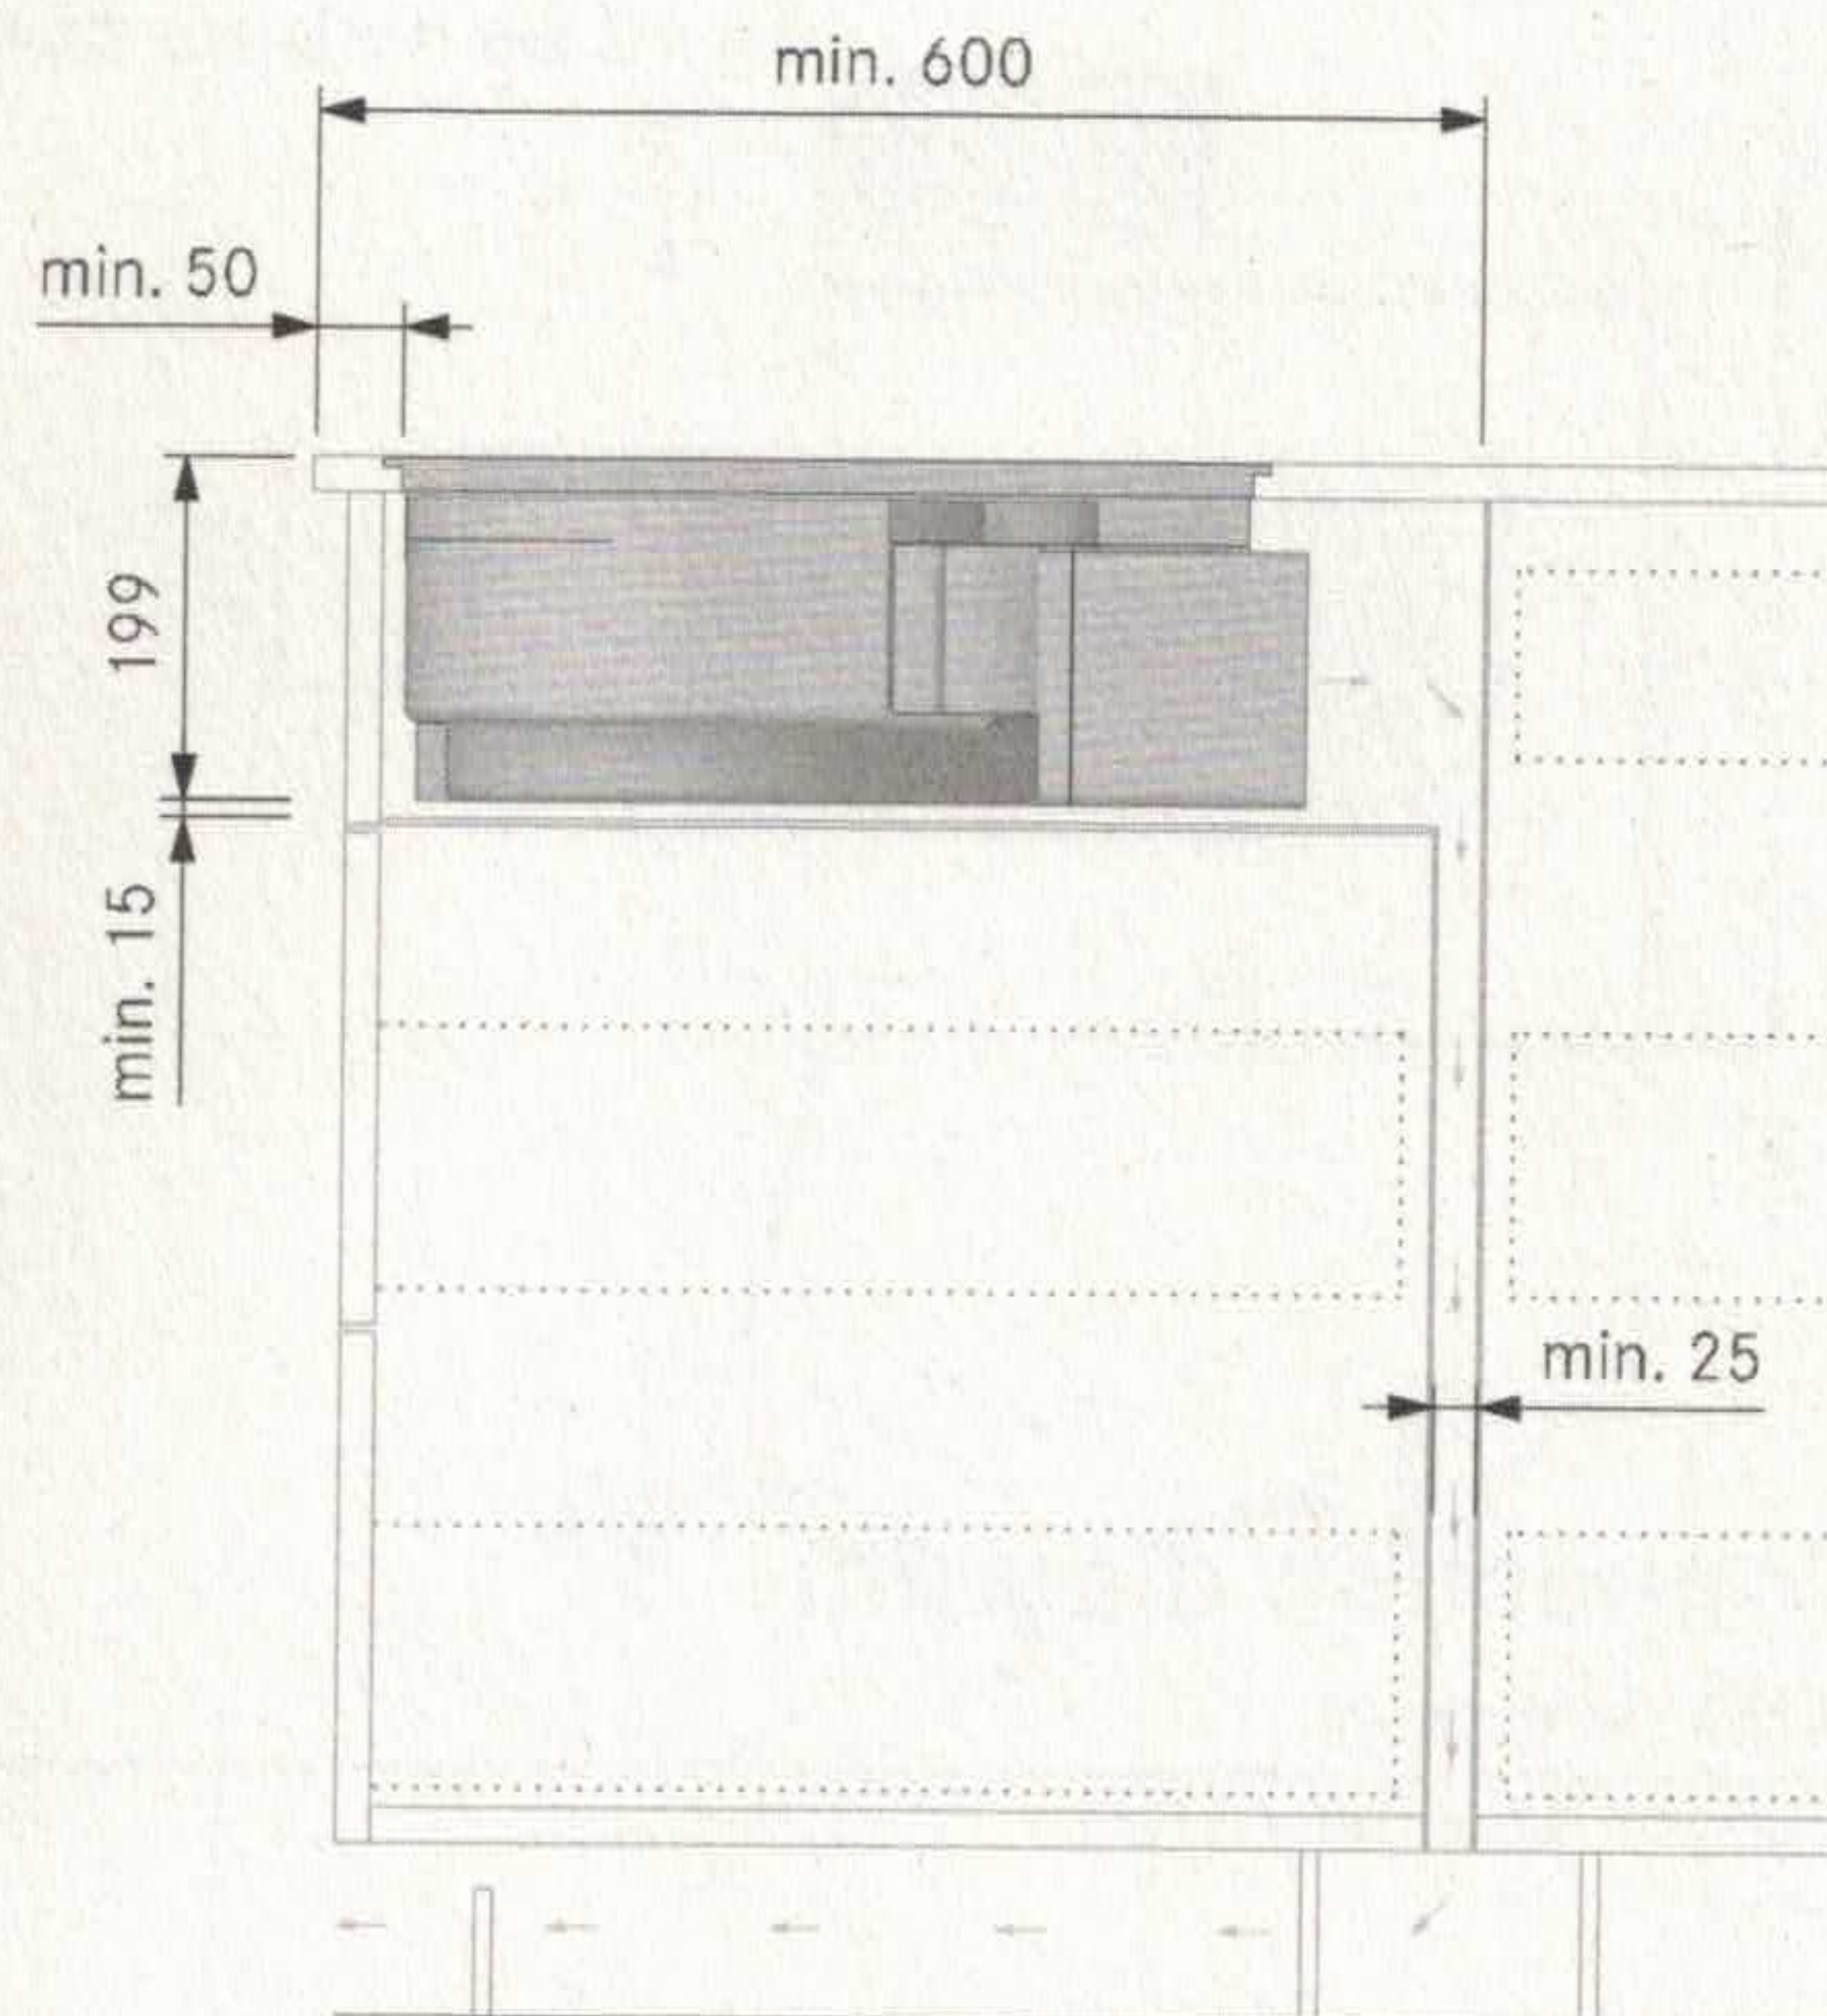

Important planning information for recirculation ducting:

To ensure optimal extraction performance, a return flow aperture of at least 500 cm² for air recirculation must be guaranteed.